



W/ CURB
NTS

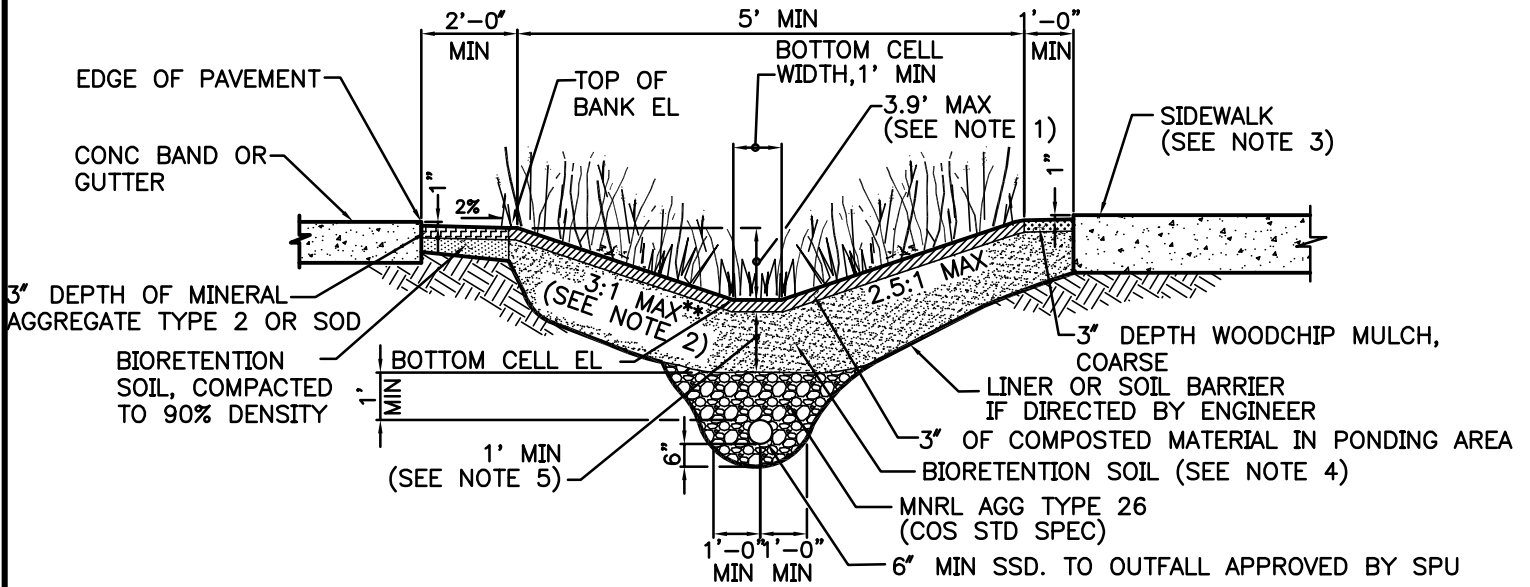

W/O CURB
NTS

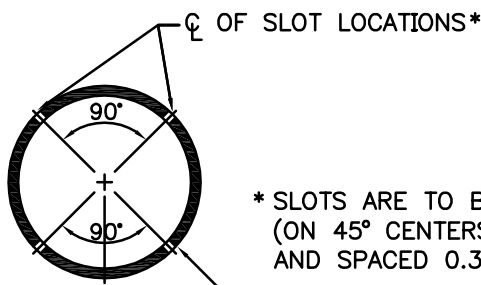

SSD SLOT DETAIL

NTS

* SLOTS ARE TO BE 0.064" WIDE
(ON 45° CENTERS) BY 1.0" LONG
AND SPACED 0.3" APART.

PVC (6" MIN DIA) PER ASTM D1785, SCH 40

NOTE:

1. DEPTH OVER 4' REQUIRES GUARD RAIL.
2. 4:1 MAX WHEN WITHIN 50- FEET OF INTERSECTIONS
3. SIDEWALK ELEVATION MUST BE SET ABOVE OVERFLOW ELEVATIONS.
4. SCARIFY SUBGRADE 3" MIN BEFORE BIORETENTION SOIL INSTALLATION.
5. 1.5' MIN IF USED FOR WQ.

APPLICATION OF THESE DETAILS REQUIRE APPROVAL FROM SDOT AND SPU.



**BIORETENTION, BIOFILTRATION
CELL W/UNDER DRAIN**

JANUARY 2010

FIGURE

6-16